



**ZHEJIANG JMTHY PV TECHNOLOGY CO., LTD**

No. 158 Jinci Road, Hangzhouwan New zone Cixi Ningbo City

Web: <http://www.jmthy.com>



## ***JMS-F Rapid Shutdown Box***

VER 5.0



**LISTED**

**ZHEJIANG JMTHY PV TECHNOLOGY CO., LTD**

No. 158 Jinci Road, Hangzhouwan New zone Cixi Ningbo City

Web: <http://www.jmthy.com>

## Unpacking and storage



1-1

1-2

Part#	Description	Number
1-1	JMS-F Rapid Shutdown Box	40
1-2	Installation/User Manual	1

## Revision History

Revision	Date	Reason
V1.0	15-05-2019	First version
V2.0	27-06-2020	Parameter update
V3.0	28-09-2020	Enclosure changes
V4.0	14-07-2021	Potting material change
V5.0	01-03-2023	Enclosure and metal buckle changes



## TABLE OF CONTENTS

1. IMPORTANT SAFETY INSTRUCTIONS	3
2. FUNCTION DESCRIPTION	5
3. SIZE OF JMS-F	8
4. TECHNICAL PARAMETERS	9
5. TURN-ON MODE OF JMS-F	10
6. INITIATING RAPID SHUTDOWN	11
7. CONTROLLED CONDUCTOR	12
8. INSTALLATION STEPS	13
9. SYSTEM INSTALLATION TEST	17
10. REPLACE A JMS-F	18

## 1. IMPORTANT SAFETY INSTRUCTIONS

SAVE THESE INSTRUCTIONS - This manual contains important instructions for JMS-F that must be followed during installation and maintenance of the JMS-F. To minimize the risk of electric shock and to ensure a safe installation of JMS-F and for it to function properly, A warning symbol will appear throughout this document to indicate dangerous conditions may apply and highlight the important safety instructions.

### Levels of warning messages

The following levels of warning messages may occur when handling the JMS-F.

<b>⚠ DANGER</b>
Indicates a hazardous situation which, if not avoided, will result in death or serious injury.
<b>⚠ WARNING</b>
Indicates a hazardous situation which, if not avoided, could result in death or serious injury.
<b>⚠ CAUTION</b>
Indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.
<b>NOTICE</b>
Indicates a situation which, if not avoided, can result in property damage.

### Target group

All installation must only be conducted by highly skilled and fully trained professional technicians with expert knowledge of safety regulation of electrical system. A complete understanding of this instruction manual is compulsory before undertaking any installation.

- Passed professional training.
- Completely read this manual and understand the safety related matters of operation.
- Familiar with the relevant safety regulations electrical systems.
- Only qualified professionals should install and/or replace the JMS-F.
- The National Electrical Code, ANSI/NFPA 70 wiring methods are to be used.
- Before undertaking any installation or using JMS-F, please read all instructions and warning marks in this technical documents. Please also take a moment to review any safety warnings on the inverter system and the PV array itself.

<b>⚠ DANGER</b>
<p><b>Danger to life due to electric shock when live components or DC conductors are touched</b></p> <p>When exposed to sunlight, the PV modules generate high DC voltage which is present in the DC conductors. Touching live DC conductors results in death or lethal injuries due to electric shock.</p> <ul style="list-style-type: none"> <li>• Do not touch non-insulated parts or cables.</li> <li>• Do not disconnect the DC connectors under load.</li> <li>• Do not disconnect the PV module from the JMS-F without first disconnecting the AC power.</li> <li>• Wear suitable personal protective equipment for all work on the JMS-F.</li> <li>• Do not attempt to undertake any repair work on the JMS-F unit, in the event of a non-functional unit, please contact our customer support team for a replacement unit. Any sign of attempt to undertake any repair on JMS-F unit will automatically void the warranty.</li> </ul>


<b>⚠ CAUTION</b>
<p><b>Risk of burns due to incompatible connectors</b></p> <ul style="list-style-type: none"> <li>• Do not use connectors from different manufacturers.</li> </ul>

## 2. Function Description

The JMTHY JMS-F is qualified as PV rapid shutdown equipment (PVRSE) which can achieve module-level rapid shutdown. Which in turn will significantly improve the safety of PV power generation systems. JMS-F uses PLC communication. The signal is transmitted by the inverter with built-in transmitter function through the DC bus. After JMS-F receives the signal, the switch turns on and the energy generated by the PV module will be delivered to the AC grid through the inverter. When an emergency situation occurs, the AC power can be turned off by switching off the AC breaker in the cabinet, so that the inverter with built-in transmitter function stops sending signals, and the JMS-F will shutdown the power output, then eliminate the high voltage on DC bus, it can improve the safety of the PV system.

The JMTHY JMS-F system is comprised of three key elements:

- PV array
- Rapid shutdown box (JMS-F)
- Inverter with built-in transmitter function

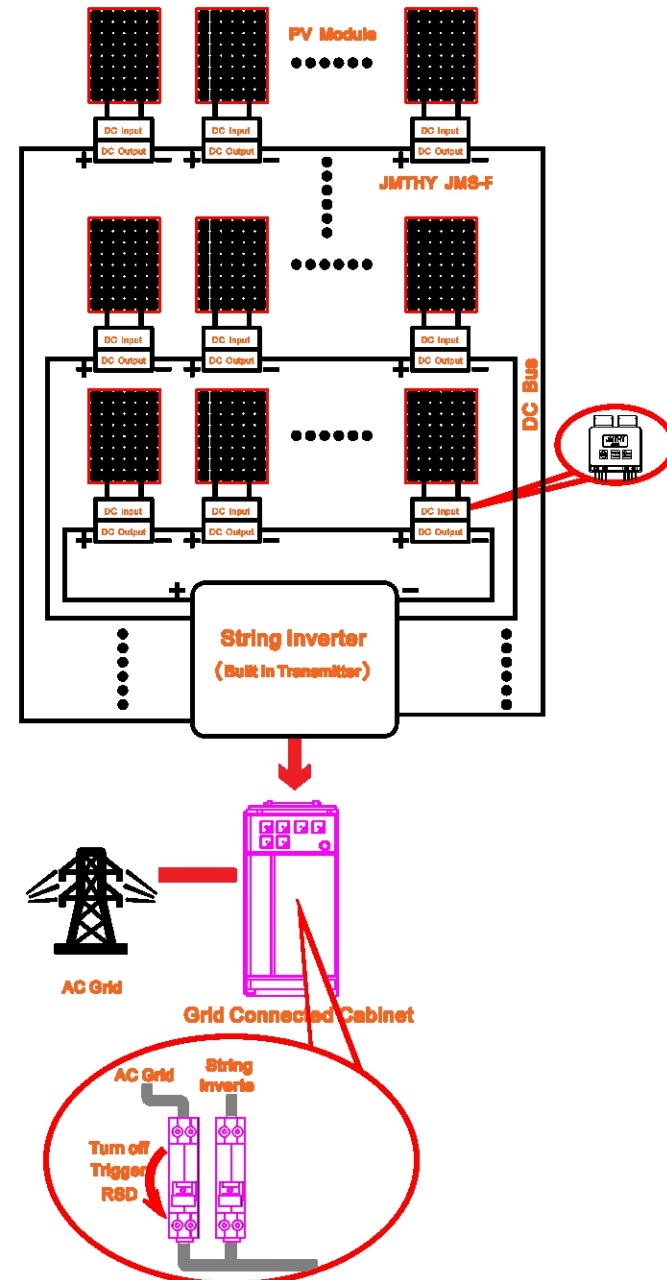

The JMS-F is mounted on the aluminum frame of the PV module. The output connector of each PV module is connected to the JMS-F input connector (black cable), and the adjacent two JMS-F in each string are connected through the output connector (red cable). Finally, the entire string is connected to the inverter. Up to 10 strings of PV modules can be connected in parallel in the system. Each string of PV modules contains at least 6PCS JMS-F and no more than 30PCS JMS-F.

**WARNING**

**Risk of electric shock due to malfunction of the PV rapid shutdown system**

This PV rapid shutdown equipment (PVRSE) does not perform all of the functions of a complete PV rapid shutdown system (PVRSS). This PVRSE will only work in conjunction with other equipment to form a complete PVRSS that meets the requirement of NEC (NFPA 70) section 690.12 for controlled conductors outside the array. Other equipment installed within this PV system may adversely affect the overall operation of the PVRSS.

- The installer has to ensure that the completed PV system meets the rapid shutdown functional requirements. These equipment must be installed in accordance to the manufacturer's installation procedure guidelines.

**3. Size of JMS-F**

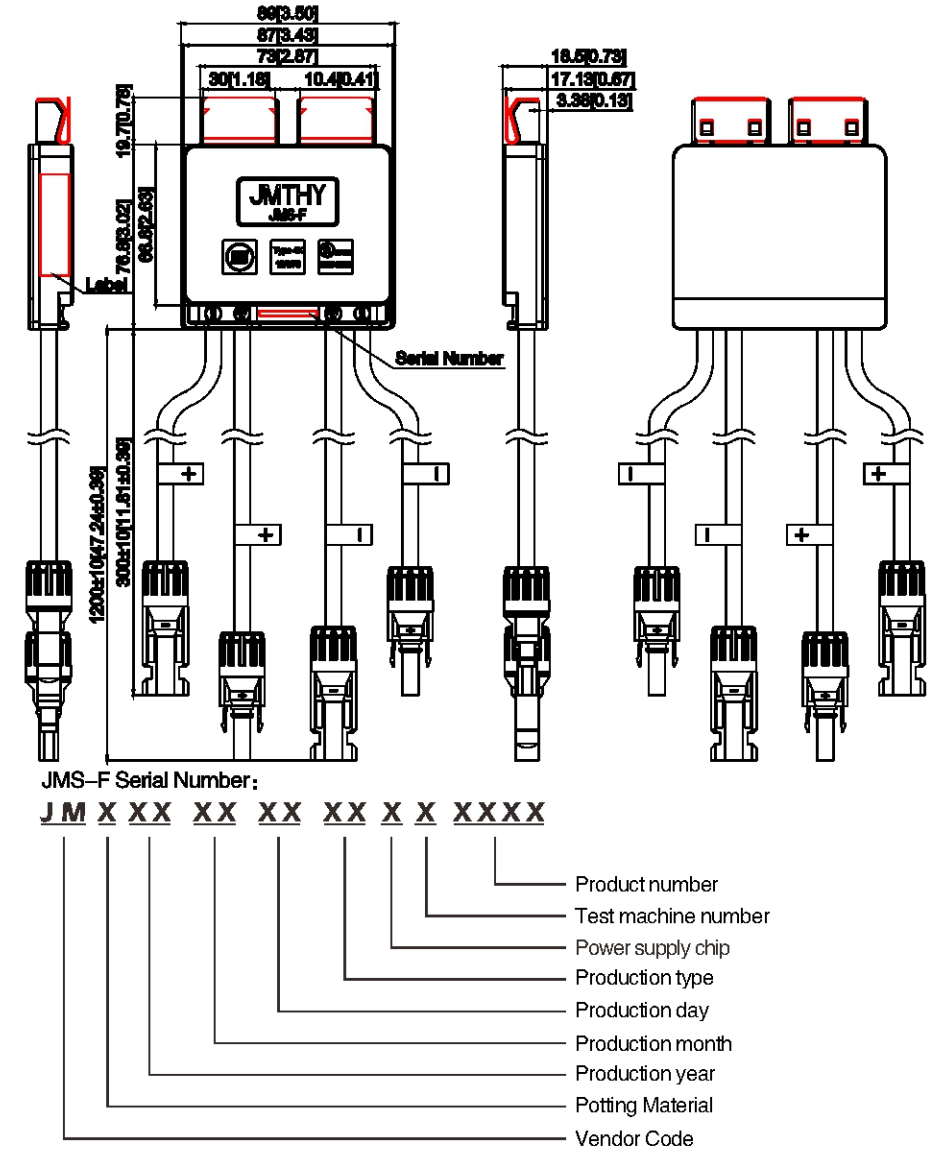


Figure: Position of the anchoring points dimensions in mm [in].

#### 4. Technical Parameters

Model	JMS-F
Input Operating Voltage Range (DC)	10V~60V
Max Input Voltage (Voc)	60V
Max System Voltage	1500V
Max Input Current (DC)	15A
Max Input Short Circuit Current (DC)	15A
Rapid Shutdown Time	Within 10s
Operating Temperature Range	-40°C~75°C(-40°F~167°F)
Rated DC Input Power	600W
Output Power Range	0W~600W
Cable Type	PV wire 4mm <sup>2</sup> /12 AWG
Outer Diameter of the Cable	∅6.7±0.25mm (∅0.26±0.01in)
Connector Type	MC4
Product Weight	439g±6g(0.971lb±0.01lb)
Communication Protocol	Compliant with SunSpec transmitter
Enclosure Rating	Type 4X
Rapid Shutdown UL Listed	E504335, meeting NEC 2017 690.12
Communication	PLC


#### ⚠ CAUTION

##### Risk of fire due to overheating or damage of the JMS-F

The usage of the JMS-F outside the above specified technical range may lead to overheating.


- JMS-F must be used within the specified temperature range and its electrical performance boundaries as rated in these technical parameters.

#### 5. Turn-on Mode of JMS-F

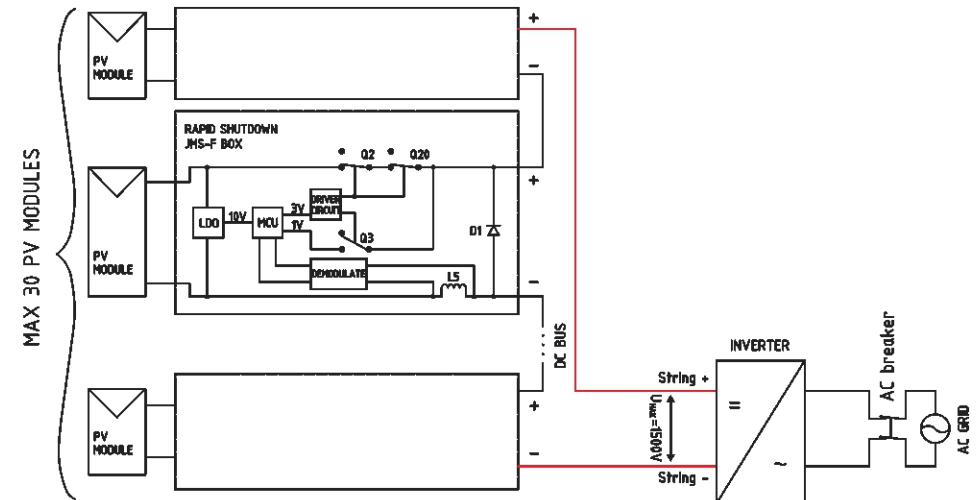

When the AC breaker is closed, the inverter with built-in transmitter function sends the signal keep alive through the DC bus. JMS-F receives the signal and enters the turn-on mode. Then the MOSFET Q3 is turned off and the MOSFET Q2/Q20 is turned on. JMS-F turns on and the energy generated by the PV module will be delivered to the AC grid through the inverter.

### 6. Initiating Rapid Shutdown

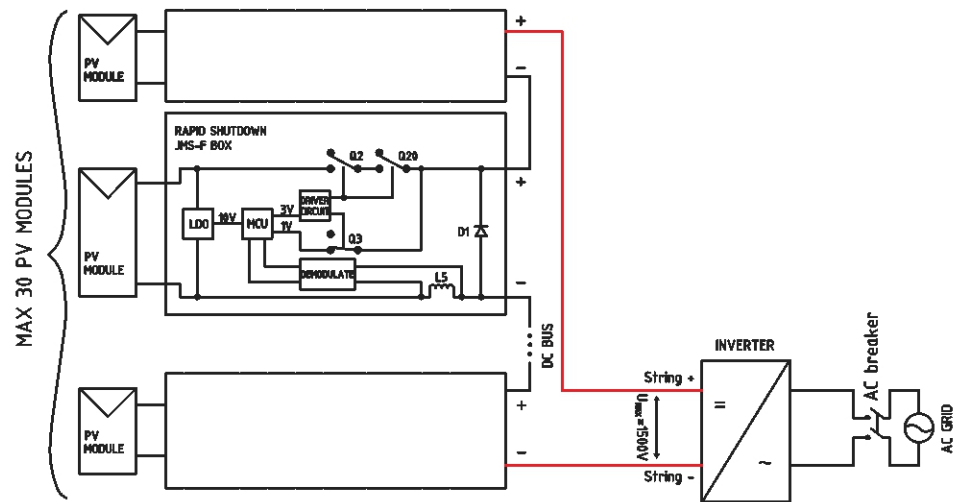


When the AC breaker is turned off, the inverter with built-in transmitter function stops sending the signal keep alive through the DC bus. JMS-F does not receive the signal and waits for 10 seconds to enter the turn-off mode. Then the MOSFET Q3 is activated and the MOSFET Q2/Q20 is deactivated, the output voltage of JMS-F is 1 Volt, and the PV system is in the no-load state.

#### Rapid shutdown steps:

- STEP1: Switch off the AC breaker on the AC side of the PV system.
- STEP2: The inverter with built-in transmitter function stops sending signals, thus initiating rapid shutdown.
- STEP3: Each JMS-F does not receive the signal then executing rapid shutdown, the output voltage of each JMS-F is 1 Volt.
- STEP4: At the final stage the DC bus voltage of the PV system drops to below 30 Volts within 30 seconds.

### 7. Controlled Conductor

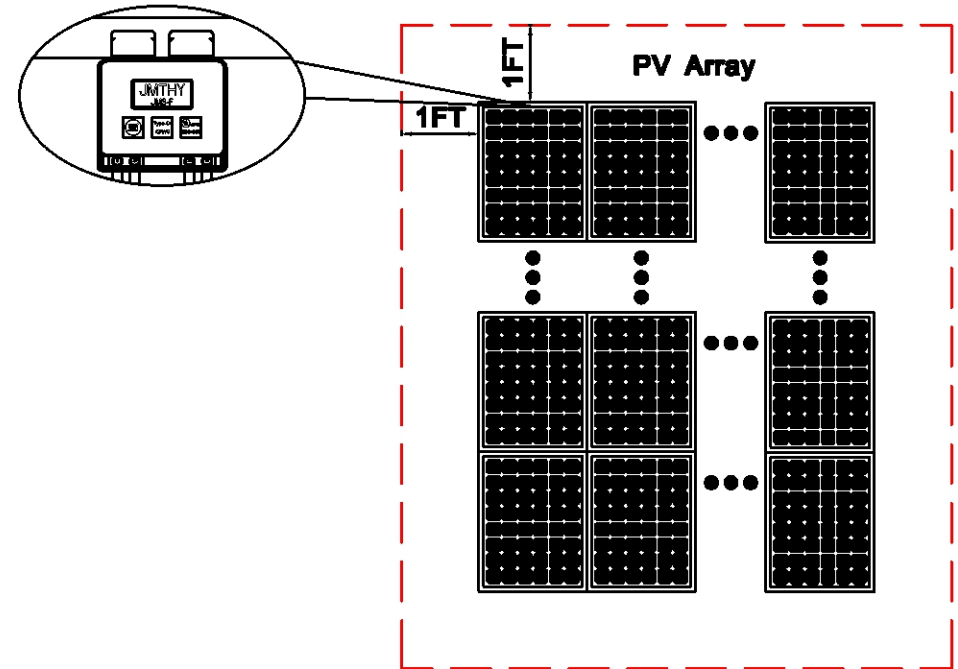

The JMTHY JMS-F can detect any rapid disconnection between each PV module in critical situations, thus eliminating the DC high voltage present in the PV system array, reduces the risk of electric shocks for rescue operation. JMS-F achieves shutdown within 10 seconds, the voltage is reduced to less than 80 Volts within the distance limit of 1 foot from the PV array, while the DC cable voltage from 1 foot outside the PV array to the inverter input drops below 30 Volts. The conductors within the dashed line shown above are all controlled conductors.

## 8. Installation Steps

JMS-F installation is straightforward. All JMS-F units comes equipped with a metal buckle that can be easily attached to the aluminum frame of the PV module. Simply insert the buckle of the JMS-F into the aluminum frame of the PV module and make sure that the installation is firm

### ⚠ WARNING

#### Risk of electric shock or fire due to malfunction of the PV rapid shutdown system

Using the JMS-F outside the technical specification leads to damages of the device and its isolation.

- Make sure you verify the voltage, current and power specification of your PV modules and match with the JMS-F specifications.
- Make sure the DC operation voltage range of the PV module is within the allowable input voltage range of the JMS-F.
- For use with the JMS-F, the marked maximum open circuit voltage and maximum short circuit current for PV modules must be calculated using the module manufacturers published ratings, temperature coefficients and the expected local irradiance which will be present in the end use installation.
- Please make sure the inverter has open circuit protection function, if not using fuse/breaker.

### A. Install the JMS-F onto the PV module

Insert two metal clips into the PV module aluminum frame (shown in Red).


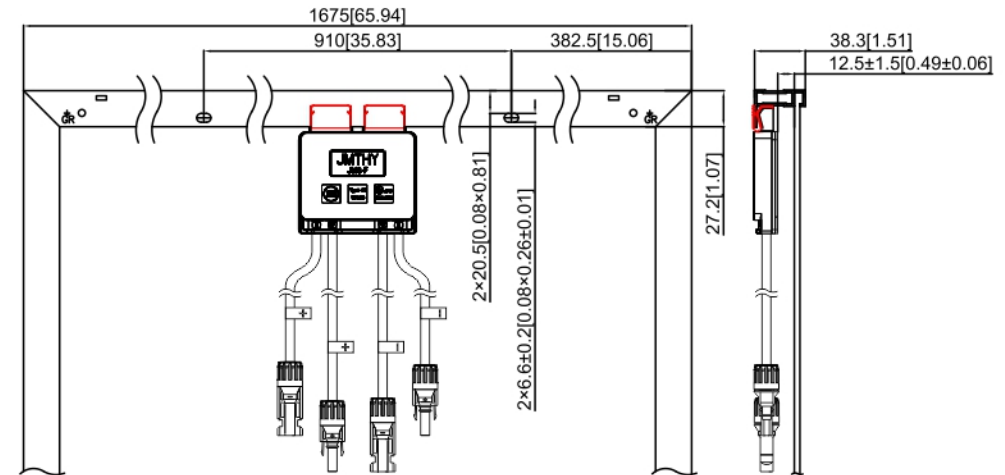


Figure: Position of the anchoring points dimensions in mm [in].

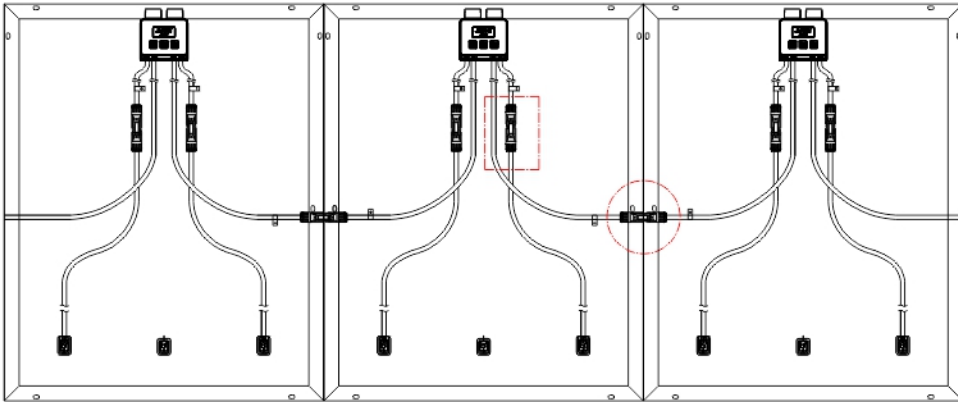

## B.The connection between two adjacent JMS-F

**WARNING****Danger to life due to high voltages**

Wrong connection of the input and output connectors lead to a malfunction of the JMS-F device and the rapid shutdown system.


- Ensure proper connection of the JMS-F input and output connector terminals.
- Ensure the right polarity of the input and output connectors.

**NOTICE**

Risk of some JMS-F in the system not be operated normally due to exceeding the specified quantity.

- 6 to 30 PV modules/JMS-F in series. 1 to 10 strings of PV modules/JMS-F in parallel. Ensure proper connection of the JMS-F input and output connector terminals.

C.Connecting the parallel JMS-F strings to the inverter.

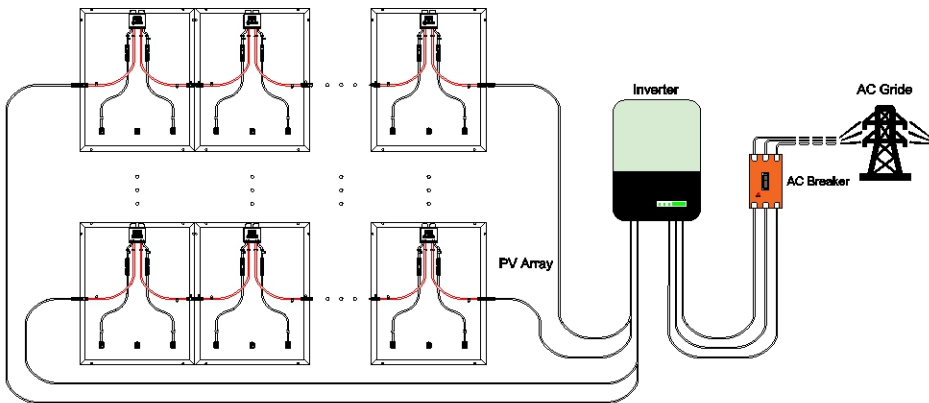

## 9. System Installation Test

After completion of the JMS-F installation based on the specified instructions above, a system installation test must be performed.

- Start by switching on the DC side switch, then continue with the AC side. Verify that each JMS-F in the system is on "power up" mode and the output voltage matches the voltage of the PV module.
- The next step is to switch off the AC side, and verify each JMS-F in the system is on the "power off" mode and output voltage is at 1 Volt.

## 10. Replace a JMS-F

Follow the procedure to replace a JMS-F:

In the order shown below:

- (1) Disconnect the AC by switching off the AC side switch.
- (2) Disconnect the DC by switching off the DC side switch of the inverter.
- (3) Wait for at least 5 minutes after switching off the power and then disconnect the PV module with the JMS-F.
- (4) Remove the JMS-F from the aluminum frame of the PV module.
- (5) Install a replacement JMS-F to the aluminum frame of the PV module.
- (6) Switch on the DC side switch and then switch on the AC side switch and recover the system.

### ⚠ DANGER

**Danger to life due to electric shock when live components or DC conductors are touched**

When exposed to sunlight, the PV modules generate high DC voltage which is present in the DC conductors. Touching live DC conductors results in death or lethal injuries due to electric shock.

- Only qualified and highly skilled professionals should undertake the replacement work of JMS-F.

## JMTHY Service Contact Information,

**Contact:** jmthy.service

**Address:** JMTHY, NO.158 Jinci Road, Hangzhouwan Zone,Cixi, Ningbo, China

**Email:** jmthy.service@nbjiaming.com

**Tel:** +86-574-63537888